

All ideas, designs, arrangement and plans indicated or represented by this drawing are the property of Panda Express Inc. and were created for use on this specific project. None of these ideas, designs, arrangements or plans may be used by or disclosed to any person, firm, or corporation without the written permission of Panda Express Inc.

[illegible]

	PERMIT	10-02-20
	BID SET	
	10-28-20	




2948 N. Stemmons Freeway
Dallas, Texas 75247-6103
Phone: (214) 637-6299 www.rara.net

TRUE WARM & WELCOME
2122 MEMORIAL BLVD.
MURFREESBORO, TN

TRUE WARM & WELCOME 2300 R2

ISSUE FOR PERMIT 10-02-20

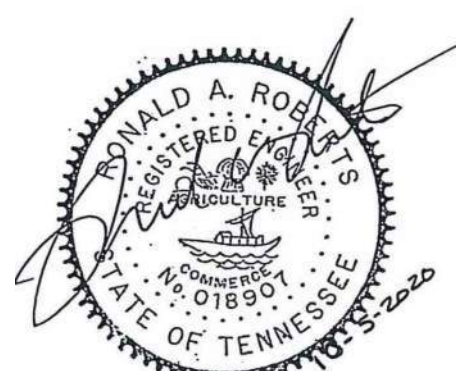

1. REF. SHEET S-000 FOR STRUCTURAL NOTES AND SPECIAL INSPECTIONS.
2. REF. 3/5-201 FOR TYPICAL PIPE AND TRENCH DETAIL AS REQUIRED.
3. REF. 4/5-201 FOR TYPICAL SILL PLATE BOLT DETAIL AS REQUIRED.
4. REF. 5/5-201 FOR TYPICAL STEP FOOTING DETAIL AS REQUIRED.
5. REF. 6/5-201 FOR TYPICAL GRADE BEAM STIRRUP DETAIL AS REQUIRED.
6. REF. 7/5-201 FOR TYPICAL REINFORCING BAR DETAIL AS REQUIRED.
7. REF. 8/5-201 FOR TYPICAL CORNER BAR DETAIL AS REQUIRED.
8. REF. 9/5-201 FOR TYPICAL BEARING DETAIL AT CONNECTION AT SLAB AS REQUIRED.
9. REF. 3/5-301 FOR TYPICAL FRAMING NOTCHES DETAIL AS REQUIRED.
10. REF. 4/5-301 FOR TYPICAL WALL FRAMING DETAILS AS REQUIRED.
11. REF. 11/5-200 FOR TYPICAL TRASH ENCLOSURE DETAIL AS REQUIRED.
12. REF. 9/5-201 FOR TYPICAL CURB DETAIL AS REQUIRED.
13. REF. 15/5-200 FOR TYPICAL LIGHT POLE BASE DETAIL AS REQUIRED.
14. REF. 16/5-200 FOR TYPICAL UMBRELLA FOOTING AS REQUIRED.
15. REF. 10/5-201 FOR TYPICAL TRENCH DRAIN DETAIL AS REQUIRED.
16. REF. 17/5-201 FOR TYPICAL DETAIL AS REQUIRED.

COORDINATE WITH ARCHITECTURAL, MECHANICAL AND PLUMBING DRAWINGS FOR LOCATIONS OF ALL DEPRESSIONS, CURBS, DRAINS, ETC. IN FLOOR SLAB.

1. USE 10d COMMON NAILS.
2. NAIL PANEL FACES @ 12" O.C.
3. USE 1/2" PLYWOOD.
4. STAGGER PLYWOOD JOINT AND SILL PLATE NAILING.
5. FRAMING MEMBERS OR BLOCKING SHALL BE PROVIDED AT THE EDGES OF ALL SHEETS IN SHEARWALLS.
6. REFER TO 9/S-200 FOR HOLD DOWN ANCHOR EMBEDMENT.
7. HOLD DOWN ANCHORS MUST BE TIED IN PLACE PRIOR TO FOUNDATION INSPECTION.
8. FRAMING AT ADJOINING PANEL EDGES SHALL BE 3 INCH NOMINAL OR THICKER AND NAILS SHALL BE STAGGERED WHERE NAILS ARE SPACED AT 3" O.C. OR ARE ON EACH FACE.

S-100

S-100
